

TEST REPORT

※This test report is excerpted test report No.21KB080202-3.

APPLICATION

Test applicant : Mitsubishi Electric Corporation
Test sample : Electric device
Test item : Floating virus removal test inside 1m³ chamber

TEST METHOD

- Virus strain : Severe acute respiratory syndrome coronavirus 2 (SARS-CoV-2);
JPN/TY/WK-521

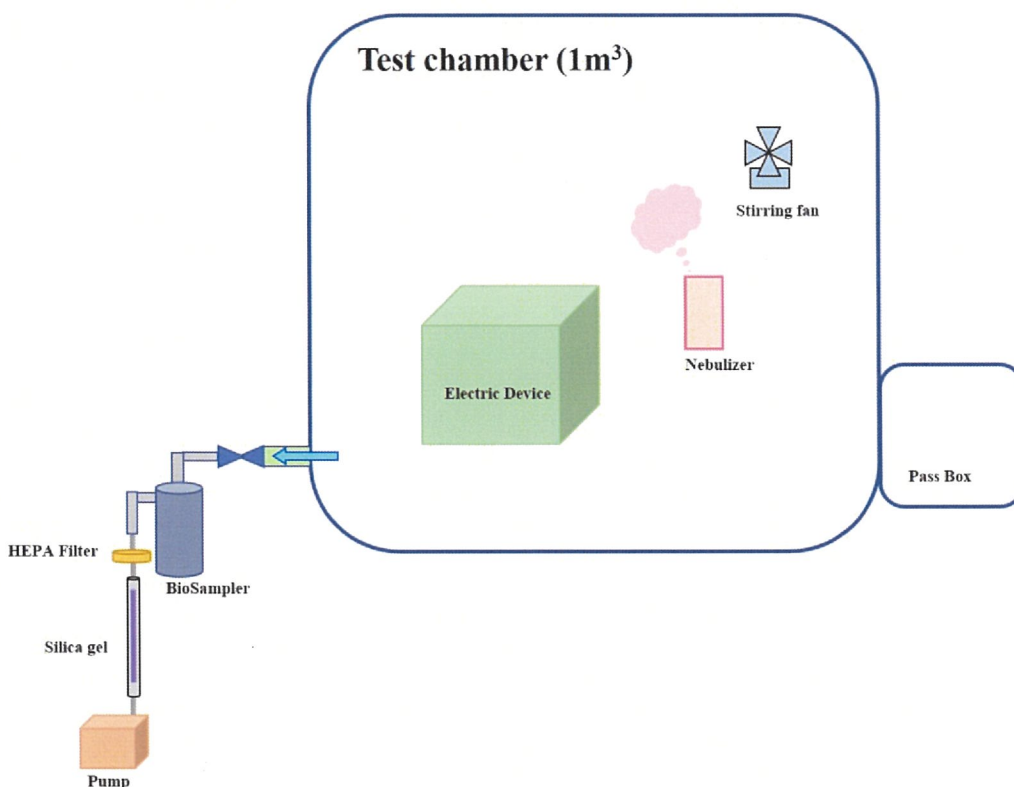


Fig.1 Summary of floating virus removal test

* Test results in this test report are only for samples received from the applicant and not for the whole lot.
* Unauthorized use of whole or part of this test report is strictly prohibited.

TEST RESULT

【Turn off the test device】

| Time | Infectivity titer (PFU/1m ³ chamber) | |
|------------|---|------------------|
| | Infectivity titer | Common logarithm |
| After 5min | 5.4×10^5 | 5.73 |

【Turn on the test device】

| Time | Infectivity titer (PFU/1m ³ chamber) | |
|------------|---|------------------|
| | Infectivity titer | Common logarithm |
| After 5min | 4.5×10^3 | 3.65 |



Yasuo Imoto

Kobe Testing Center

Japan Textile Products Quality and Technology Center

* Test results in this test report are only for samples received from the applicant and not for the whole lot.
 * Unauthorized use of whole or part of this test report is strictly prohibited.